


F.M. Building Systems Structure

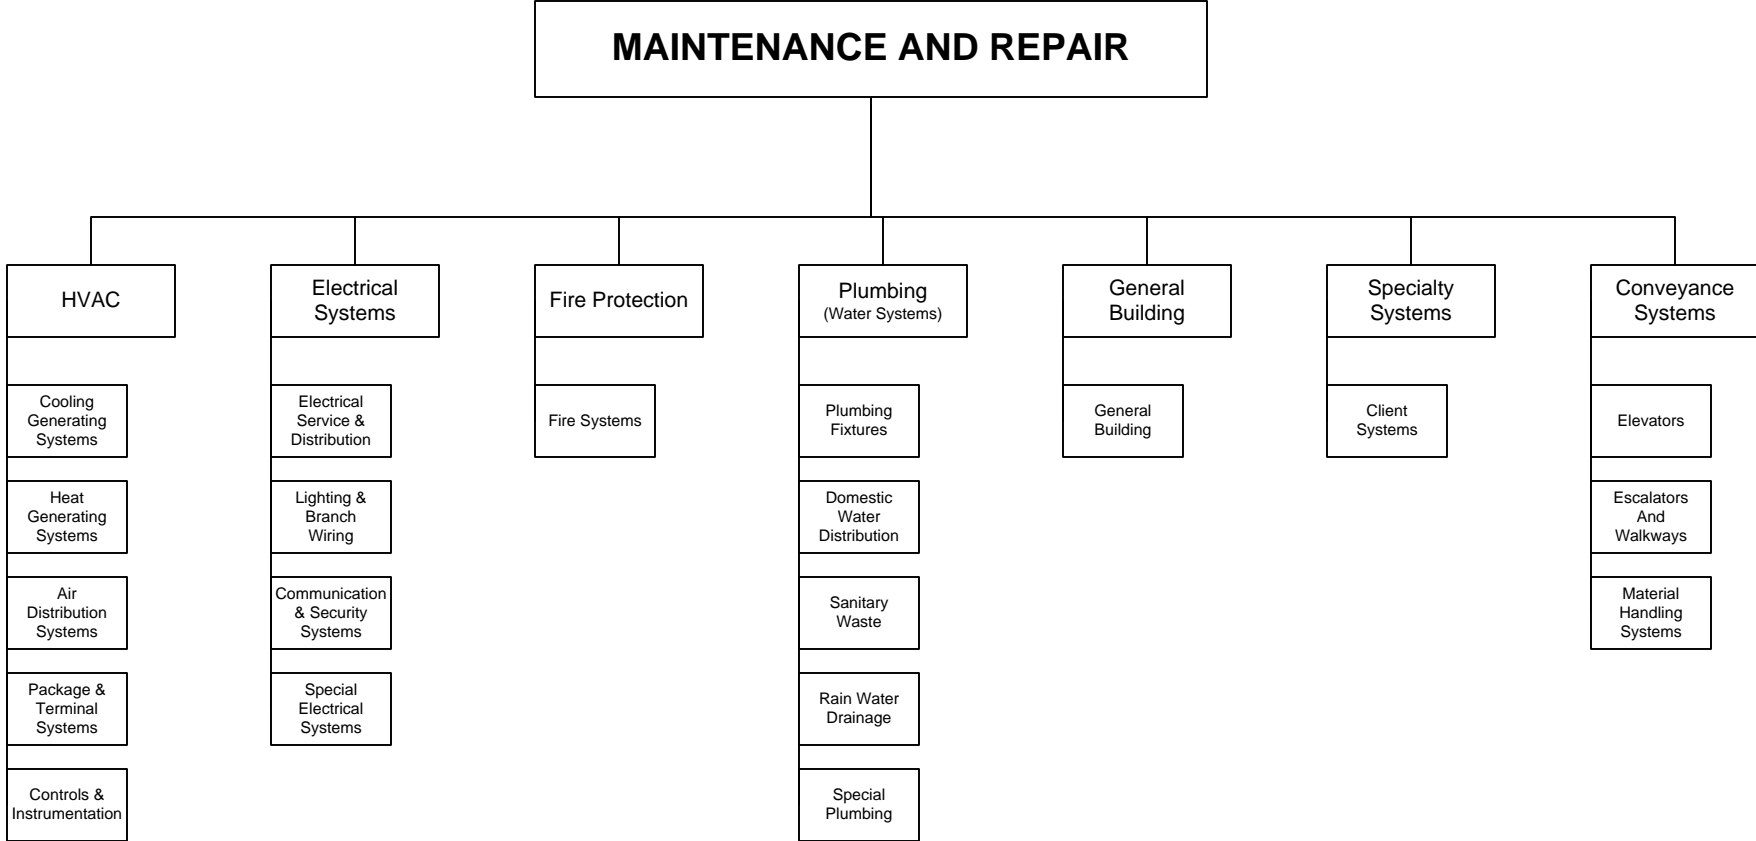


Conforms To Uniformat II Element Classifications.
 Uniformat Originally Developed By GSA (General Services Administration) And AIA (American Institute Of Architects).
 Adopted By ASTM (American Society For Testing And Materials)

MAINTENANCE AND REPAIR

HVAC

Equip Group:
HVAC SYS

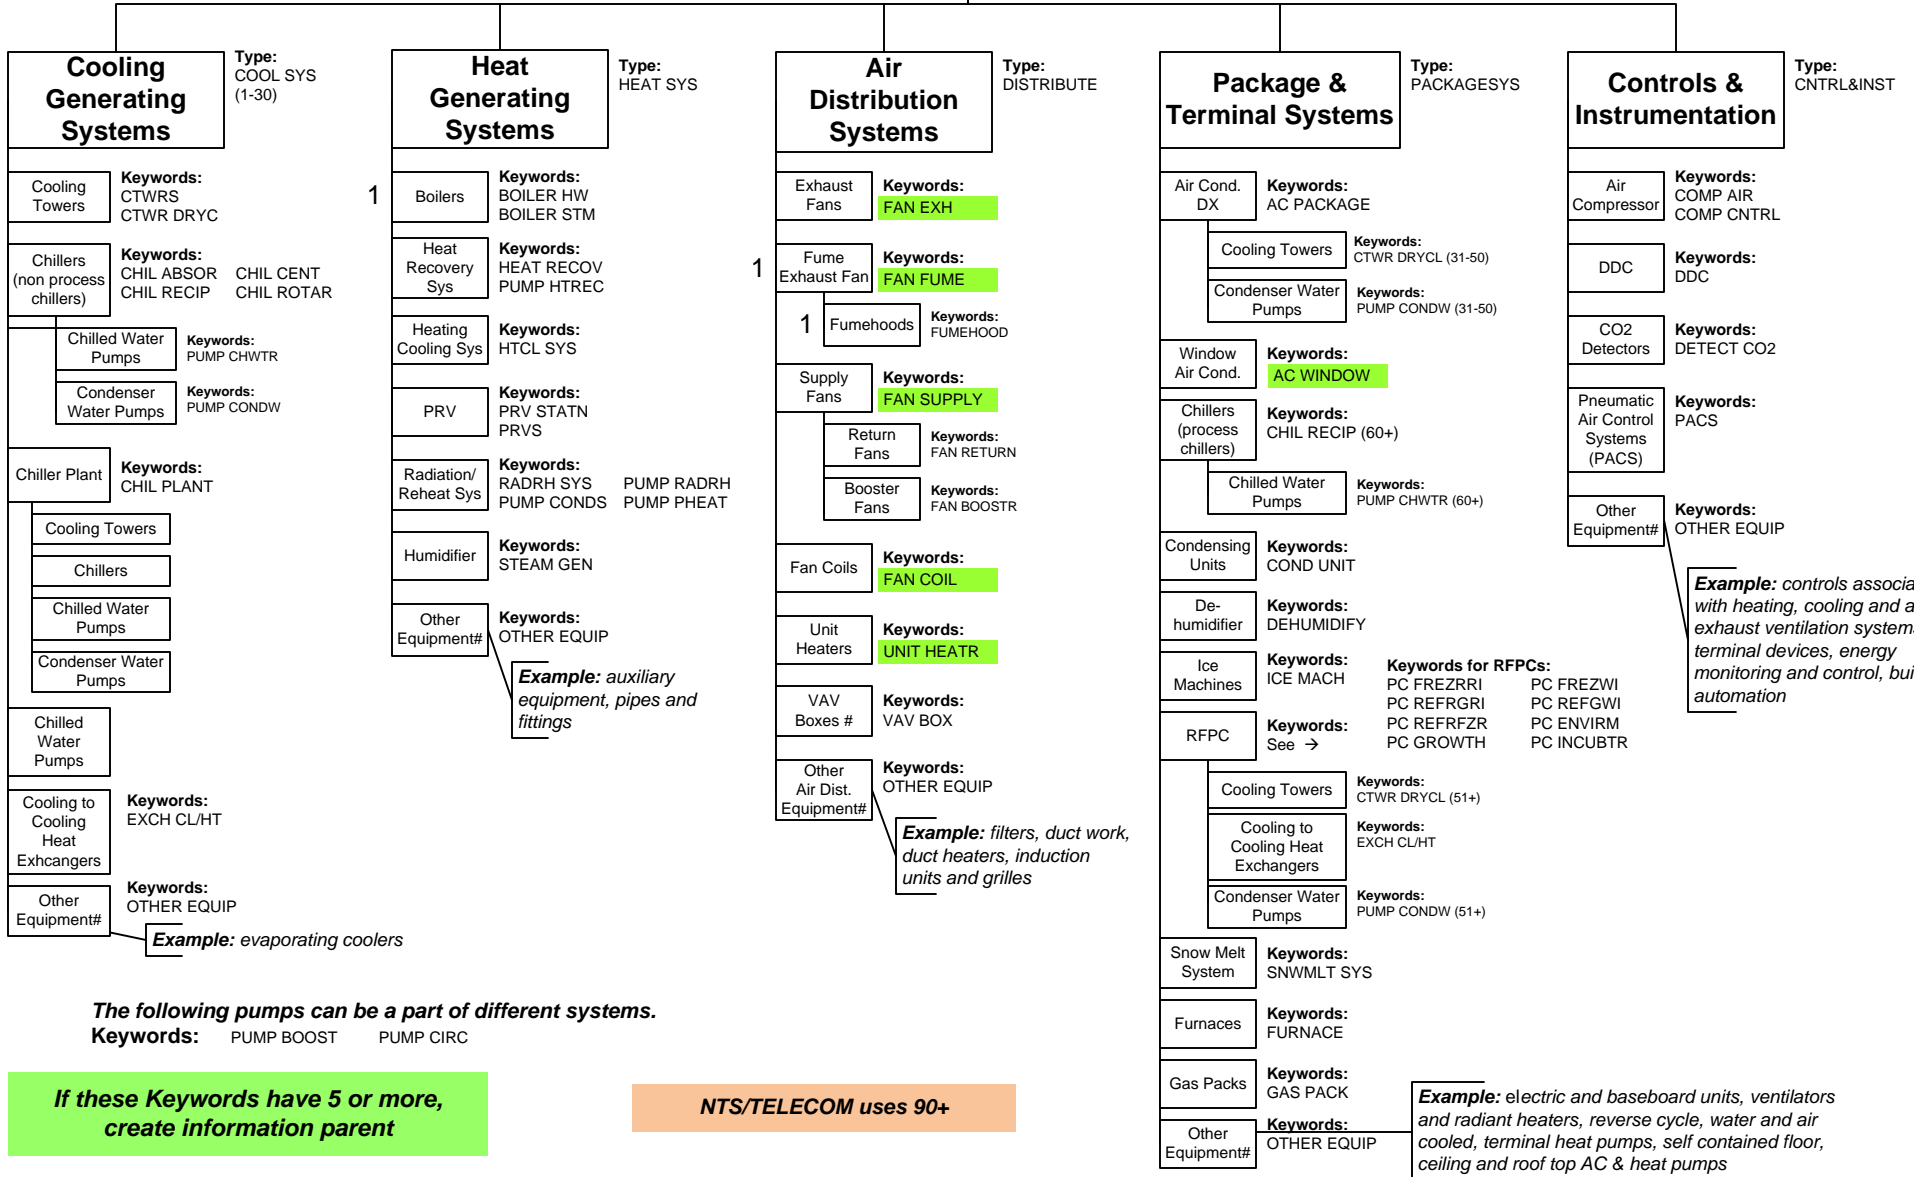


The following pumps can be a part of different systems.

Keywords: PUMP BOOST PUMP CIRC

If these Keywords have 5 or more, create information parent

NTS/TELECOM uses 90+

MAINTENANCE AND REPAIR

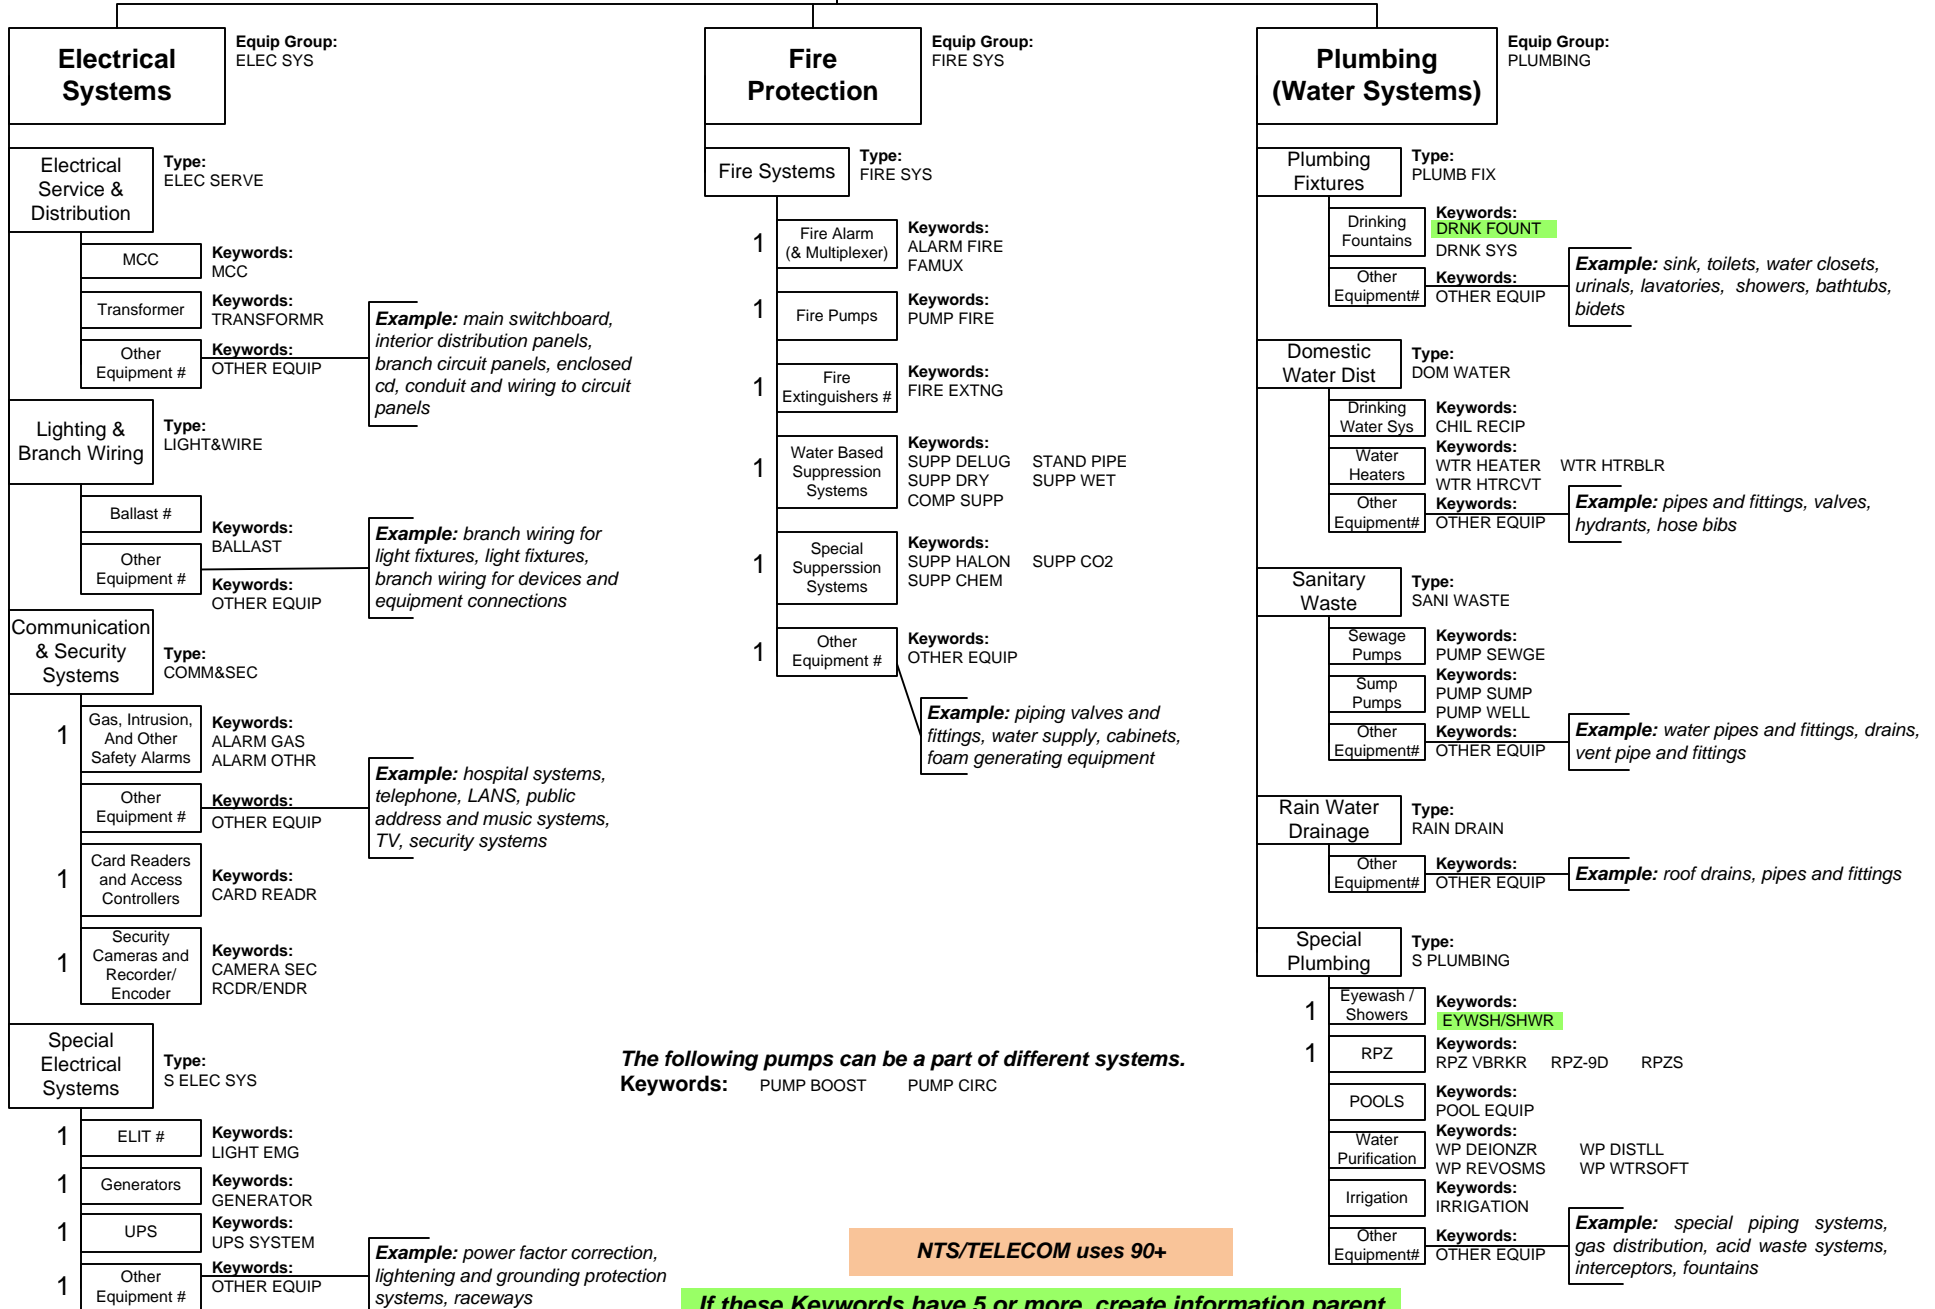


NTS/TELECOM uses 90+

If these Keywords have 5 or more, create information parent

1 in front of a box denotes it as Fire and Life Safety equipment

One equipment record per building

MAINTENANCE AND REPAIR

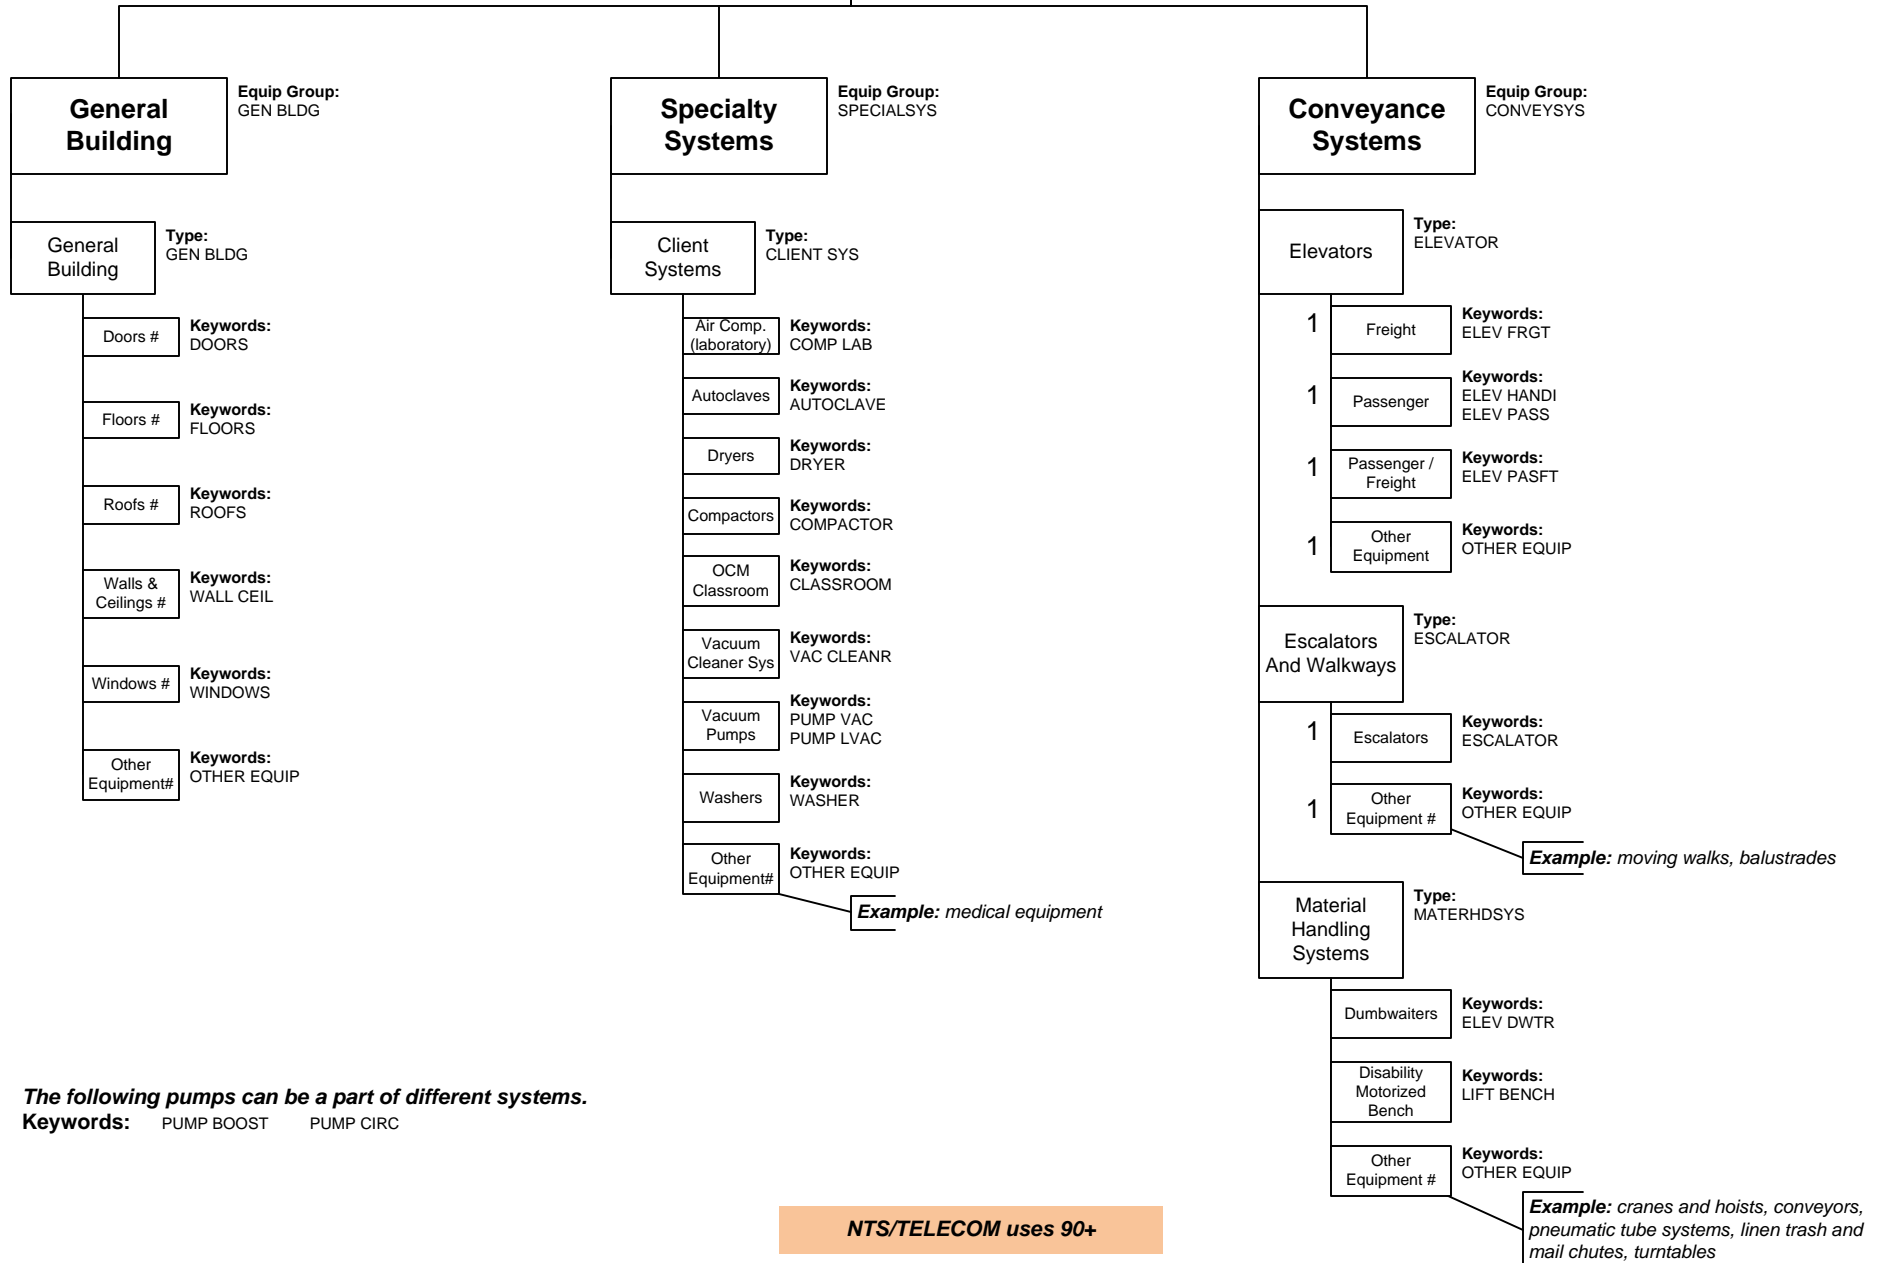

The following pumps can be a part of different systems.
 Keywords: PUMP BOOST PUMP CIRC

NTS/TELECOM uses 90+

If these Keywords have 5 or more, create information parent